



Certificate of Conformity - Particle Size Distribution 2024

Site:	Sheehan Soil Washing Plant
Material Type:	4/10 mm Washed Stone
Certificates of analysis included:	C8817,C8916, C8991 & 24-059935


Date:	Jan-25
Version:	1

Particle Size (mm)	Average % Passing	Specification for highway works series 600, Class 1B	Pass/Fail
500	100		
300	100		
125	100	100 -100	PASS
80	100		
63	100		
40	100		
31.5	100		
20	100		
16	100		
14	100		
10	79		
8	49		
6.3	19		
4	2		
2.8	1		
2	0		
1	0		
0.5	0		
0.25	0		
0.125	0		
0.063	0.1	0 - 15	PASS

Non Engineering Description
Grey fine to medium Gravel

Notes
The yearly average, indicates grading complies with series 600 earthwork specification for a 1B material.

Yearly Average - Constituents	
% Class 'X' material	0.07%
Compliant with Series 600 SHW specification	

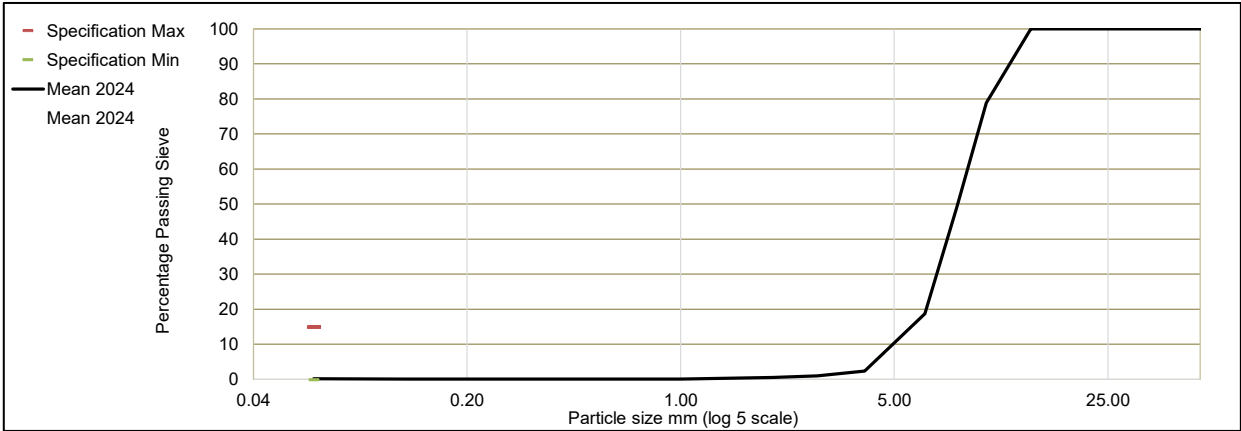

1. This is a certificate of conformity sheet for 2024.
2. The certificate uses the average of the data collected in 2024 from accredited geotechnical laboratory Terratek (Igne) Group and i2 Analytical Ltd.