



Certificate of Conformity - Particle Size Distribution 2024

Site:	Sheehan Soil Washing Plant
Material Type:	10/20 mm Washed Stone
Certificates of analysis included:	C8769, C8842, C8991 & 24-046478


Date:	Jan-25
Version:	1

Particle Size (mm)	Average % Passing	Specification based on BS EN 12620: 2002+A1 2008 (10/20).	Pass/Fail
500	100		
300	100		
125	100		
80	100		
63	100		
40	100	100 - 100	PASS
31.5	100	98 - 100	PASS
20	91	85 - 99	PASS
16	47		
14	29		
10	1	0 - 20	PASS
8	0		
6.3	0		
4	0	0 - 5	PASS
2.8	0		
2	0		
1	0		
0.5	0		
0.25	0		
0.125	0		
0.063	0.3		

Non Engineering Description
Multi-colour Gravel with concrete, brick and glass

Notes
The yearly average, indicates grading complies with BS EN 12620: 2002+A1 2008 (10/20)

Yearly Average - Constituents	
% Class 'X' material	0.00%
Compliant with WRAP Quality Protocol threshold for secondary aggregates.	

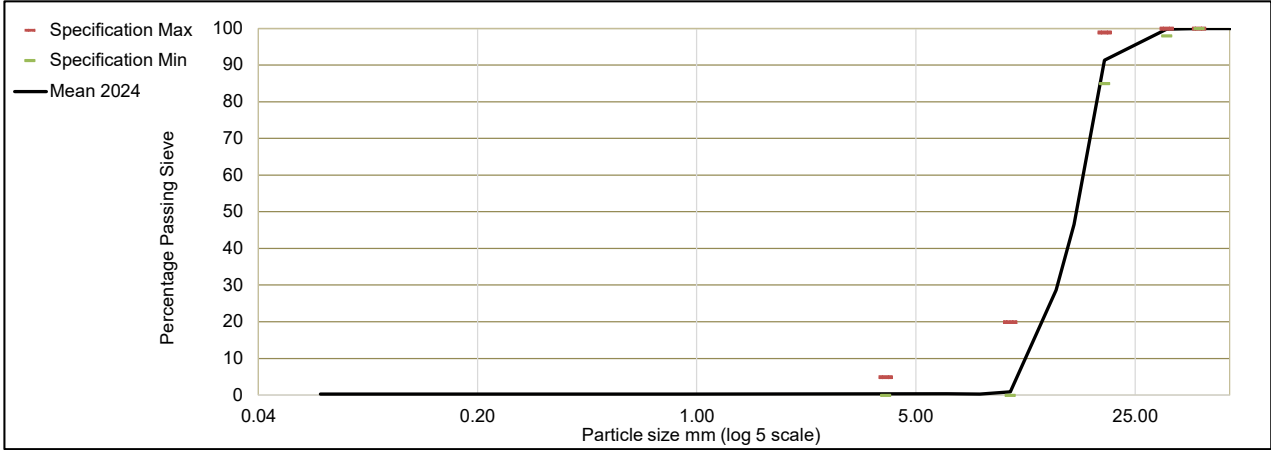

1. This is a certificate of conformity sheet for 2024.
2. The certificate uses the average of the data collected in 2024 from accredited geotechnical laboratory Terratek (Igne) Group and I2 analytical.